



SUBMITTAL DATA

FLEXX Ultra 16 SEER 36KBTU

Model: GUD36AH2/E-D(U) & GUD36W2/NHE-D(U)

Job Name

Location

Date

Purchaser

Engineer

Submitted to

For

Unit Designation

Schedule No.



GUD36AH2/E-D(U)



GUD36W2/NHE-D(U)

GENERAL FEATURES:

- AHRI Certificate: [214568826](#)
- High Efficiency DC Inverter Technology
- 24VAC Thermostat Compatible
- Zero Lot Line Design
- 8 Speed Fan Motor
- Cooling down to -15°C (5°F)
- Heating down to -30°C (-22°F)
- Designed for New Construction or Replacement Market
- Compact and Quiet, as low as 56 dB(A) Side Discharge outdoor unit
- Coil (Outdoor) Copper Tube/Aluminum Fin with Anti-Corrosion
- Coil Coating (Gold Colored Fin - 1500Hr Salt Spray Rating)
- Coil (Indoor) Copper Tube/Aluminum Fin with Anti-Corrosion
- Coil Coating (Blue Colored Fin - 500Hr Salt Spray Rating)




Tel: +1-604-370-5676
Email: Airtek@greehvac.ca
Website: GREEHVAC.ca

12720 Bathgate Way
Richmond, BC V6V 1Z4
Canada

SPECIFICATIONS & FUNCTIONS:

Outdoor Model			GUD36W2/NHE-D(U)
Indoor Model			GUD36AH2/E-D(U)
Power Supply		V/Ph/Hz	208/230V~ 60Hz
Cooling	Capacity	Btu/h	34000
	Power	W	2982
	EER2	Btu/h/W	11.4
	SEER2	-	16.5
Heating	Capacity	Btu/h	34000
	Power	W	3020
	COP2	W/W	3.30
	HSPF2	-	9.5
External Static Pressure	Rated	in.wc	0.5
	Range	in.wc	0~1.0
Outdoor Unit Dimension (W×D×H)	Outline	inch	39×14-9/16×37-13/16
	Package	inch	45-3/8×18-13/16×43-11/16
Outdoor Unit Weight	Net	lbs.	187.4
	Gross	lbs.	211.6
Indoor Unit Dimension (W×D×H)	Outline	inch	21-1/4×21-1/4×48-3/16
	Package	inch	23-3/4×26×50-3/8
Indoor Unit Weight	Net	lbs.	163.1
	Gross	lbs.	178.6
Connecting Pipe	Liquid	inch	3/8
	Gas	inch	3/4
	Max Height	ft	98
	Max Length	ft	165
Operation Temperature Range	Cooling	°F	5~129
	Heating	°F	-22~75

FAN PERFORMANCE

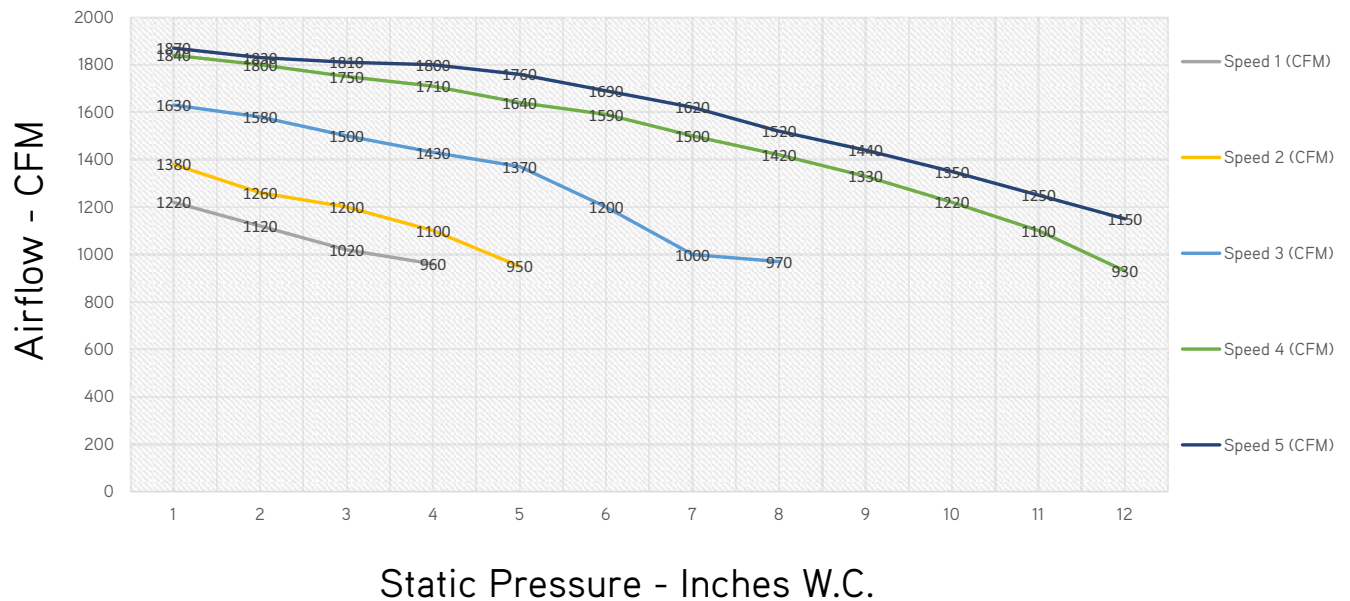

STATIC PRESSURE Inches W.C.	0	0.1	0.15	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0
Speed 1 - CFM	1220	1120	1020	960								
Speed 2 - CFM	1380	1260	1200	1100	950							
Speed 3 - CFM	1630	1580	1500	1430	1370	1200	1000	970				
Speed 4 - CFM	1840	1800	1750	1710	1640	1590	1500	1420	1330	1220	1100	930
Speed 5 - CFM	1870	1830	1810	1800	1760	1690	1620	1520	1440	1350	1250	1150

NOTE:


1. Above chart CFM ratings are based on dry coil with factory filter installed.
2. For wet coil CFM ratings, multiply the CFM by 0.96 correction factor.

DIMENSIONS

INDOOR UNIT

Unit: inch


GUD36AH2/E-D(U)	
DIMENSIONS	
A	11-5/8
B	20
H	48-3/16
W	21-1/4
D	21-1/4

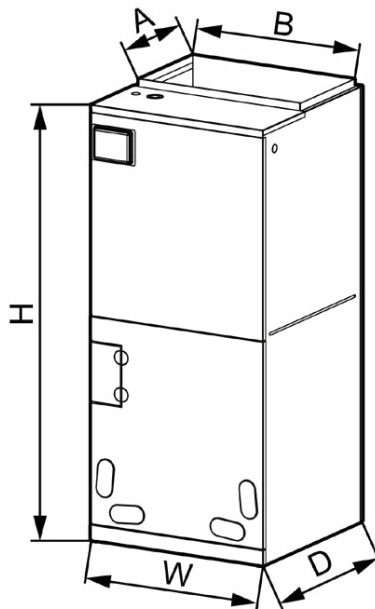


OUTDOOR UNIT

Unit: inch

GUD36W2/NhE-D(U)	
DIMENSIONS	
A	39
B	16-13/16
C	37-13/16
D	29-3/4
E	15-9/16
F	14-9/16

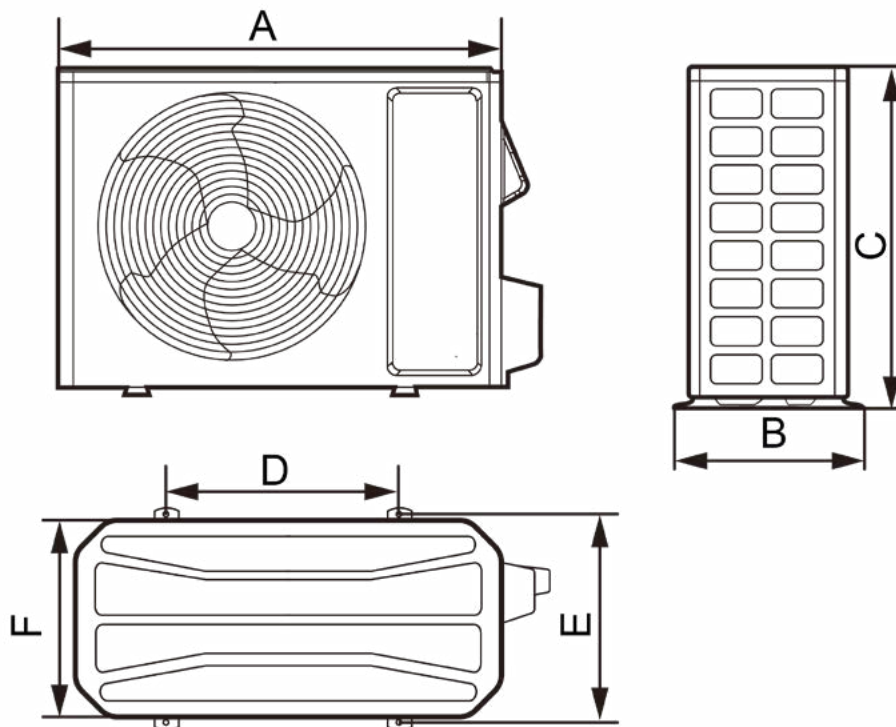

ACCESSORY HEATER AND GENERAL INFORMATION

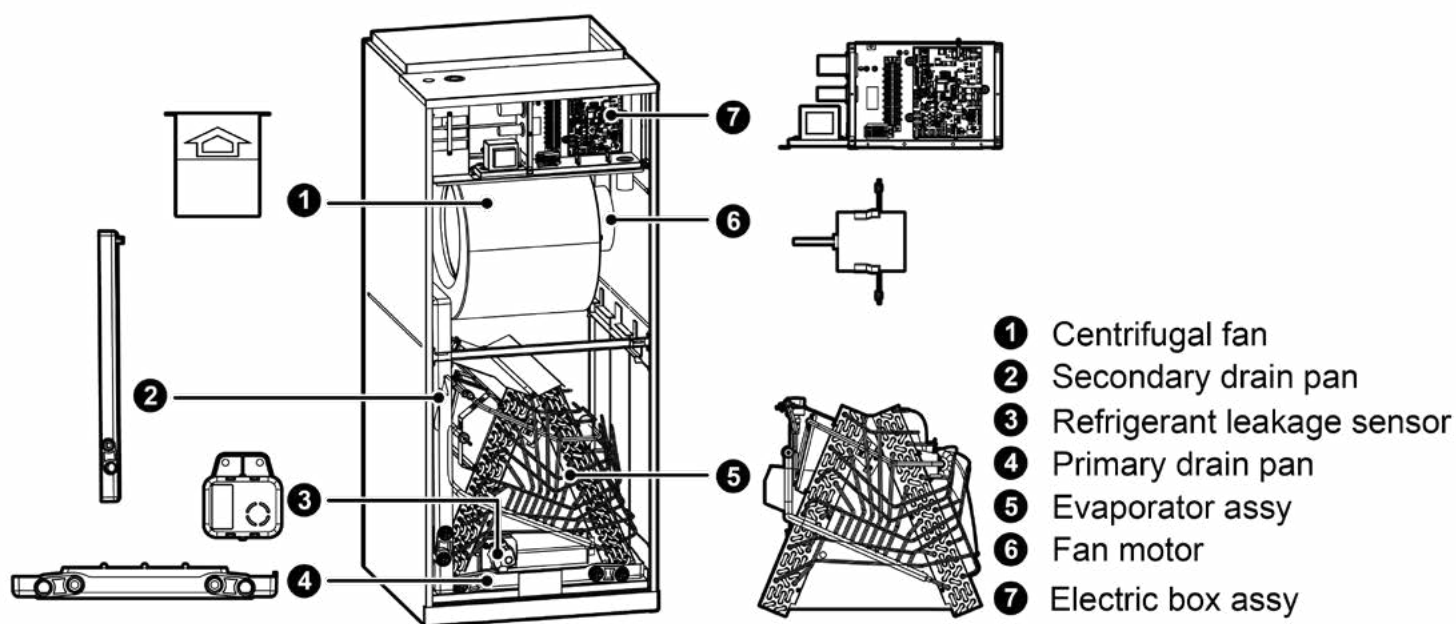

MODEL	Heat Kit Model	Part Number	Electric Heat (kW)		Min. Circuit Ampacity (A)				Max Fuse or Breaker (A)			
			208V	230V	208V		230V		208V		230V	
GUD36AH2/E-D(U)	One Mains Supply											
	320004060223	FLEXA2LHTR06	3.74	4.6	31		33		35		35	
	Two Mains Supply											
					Power A	Power B	Power A	Power B	Power A	Power B	Power A	Power B
	320004060224	FLEXA2LHTR09	6.03	7.36	32.7	13.8	35.2	15	35	15	40	20
	320004060225	FLEXA2LHTR12	7.49	9.2	32.7	27.5	35.2	30	35	30	40	35



CLEARANCES

INDOOR UNIT


Minimum clearance

FRONT

> 24

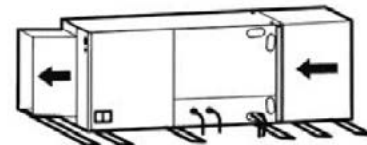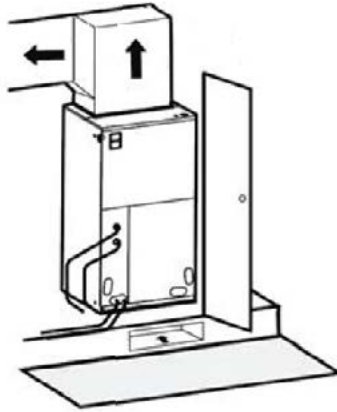

Horizontal Left Configuration - No Modification Needed

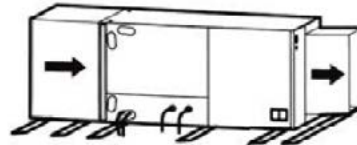

Horizontal Right Configuration - Must Relocate Drain Pan

NOTE:

Allow a minimum of 24" in front of the unit for service clearance. When installing in an area directly over a finished ceiling (such as an attic), an emergency drain pan is required directly under the unit. **See local and state codes for requirements.** When installing this unit in an area that may become wet, elevate the unit with a sturdy, non-porous material. In installations that may lead to physical damage (i.e. a garage) it is advised to install a protective barrier to prevent such damage. This air handler is designed for a complete supply and return ductwork system.

OUTDOOR UNIT


Minimum clearance

NOTE:

Install the Outdoor Unit **2 Inches** Above the Expected Snow Line

1. When one outdoor unit is to be installed.


A - E	H_b H_d H		(in)				
			a	b	c	d	e
B	-	-	-	≥ 4	-	-	-
A, B, C	-	-	≥ 12	≥ 4	≥ 4	-	-
B, E	-	-	-	≥ 4	-	-	≥ 40
A, B, C, E	-	-	≥ 12	≥ 6	≥ 6	-	≥ 40
D	-	-	-	-	-	≥ 40	-
D, E	-	-	-	-	-	≥ 40	≥ 40
B, D	$H_b < H_d$	$H_d < H$	-	≥ 4	-	≥ 40	-
	$H_b > H_d$	$H_d > H$	-	≥ 4	-	≥ 40	-
B, D, E	$H_b < H_d$		-	≥ 10	-	≥ 80	≥ 40
	$1/2H < H_b \leq H$		-	≥ 10	-	≥ 80	≥ 40
	$H_b > H$		Prohibited				
	$H_b < H_d$		-	≥ 4	-	≥ 80	≥ 40
	$1/2H < H_b \leq H$		-	≥ 8	-	≥ 80	≥ 40
	$H_b > H$		Prohibited				

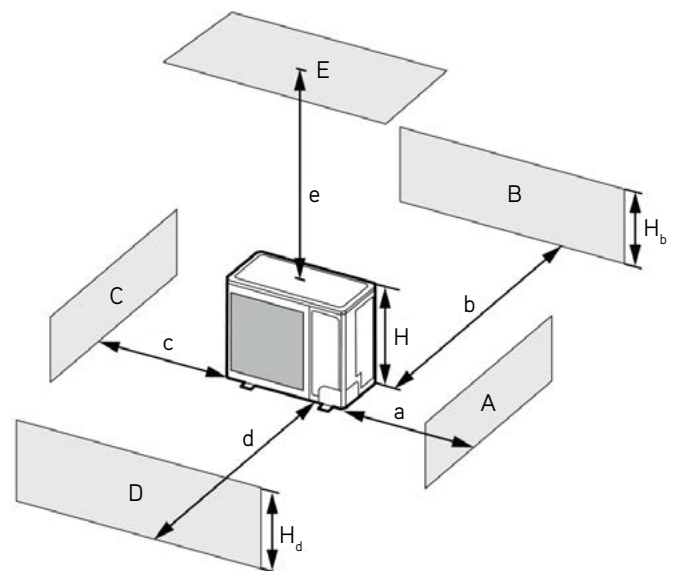

CLEARANCES


2. When two or more outdoor units are to be installed side by side.

A - E	H_b H_d H	(in)				
		a	b	c	d	e
A, B, C	-	≥ 12	≥ 12	≥ 40	-	-
A, B, C, E	-	≥ 12	≥ 12	≥ 40	-	≥ 40
D	-	-	-	-	≥ 80	-
D, E	-	-	-	-	≥ 80	≥ 40
B, D, E	$H_b < H_d$	-	≥ 12	-	≥ 80	-
	$H_b > H_d$	-	≥ 10	-	≥ 80	-
	$H_b \leq 1/2H$	-	≥ 12	-	≥ 100	-
	$1/2H < H_b \leq H$	-	≥ 12	-	≥ 80	≥ 40
	$H_b < H_d$	-	≥ 12	-	≥ 100	≥ 40
	$H_b > H$	Prohibited				
	$H_d \leq 1/2H$	-	≥ 10	-	≥ 100	≥ 40
	$H_b > H_d$	-	≥ 12	-	≥ 100	≥ 40
		$H_d > H$ Prohibited				

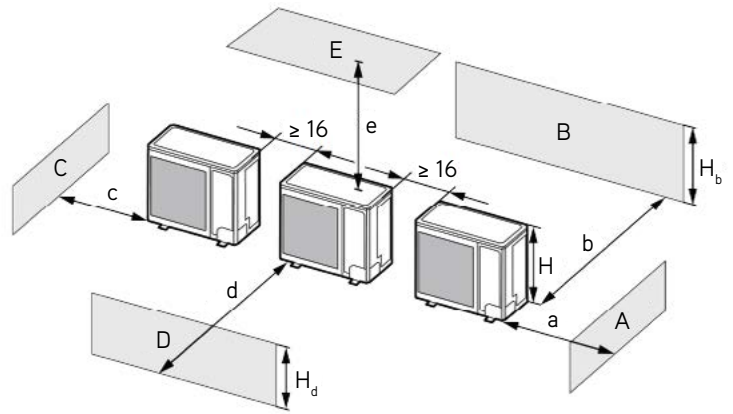

3. When outdoor units are installed in rows.

H_b H_d	(in)
$H_b \leq 1/2H$	$b \leq 10$
$1/2H < H_b \leq H$	$b \leq 12$
$H_b > H_d$	Prohibited

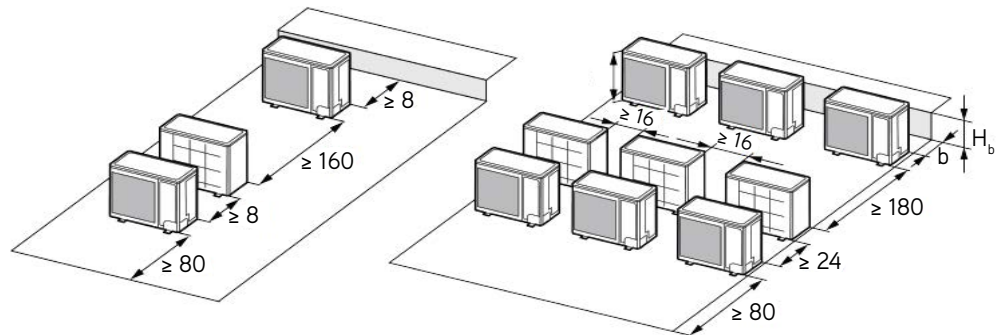

4. When outdoor units are installed one above another.

